




System No. C-AJ-2591

March 09, 2011

F Ratings — 2 and 3 Hr

T Ratings — 1 and 2-1/2 Hr

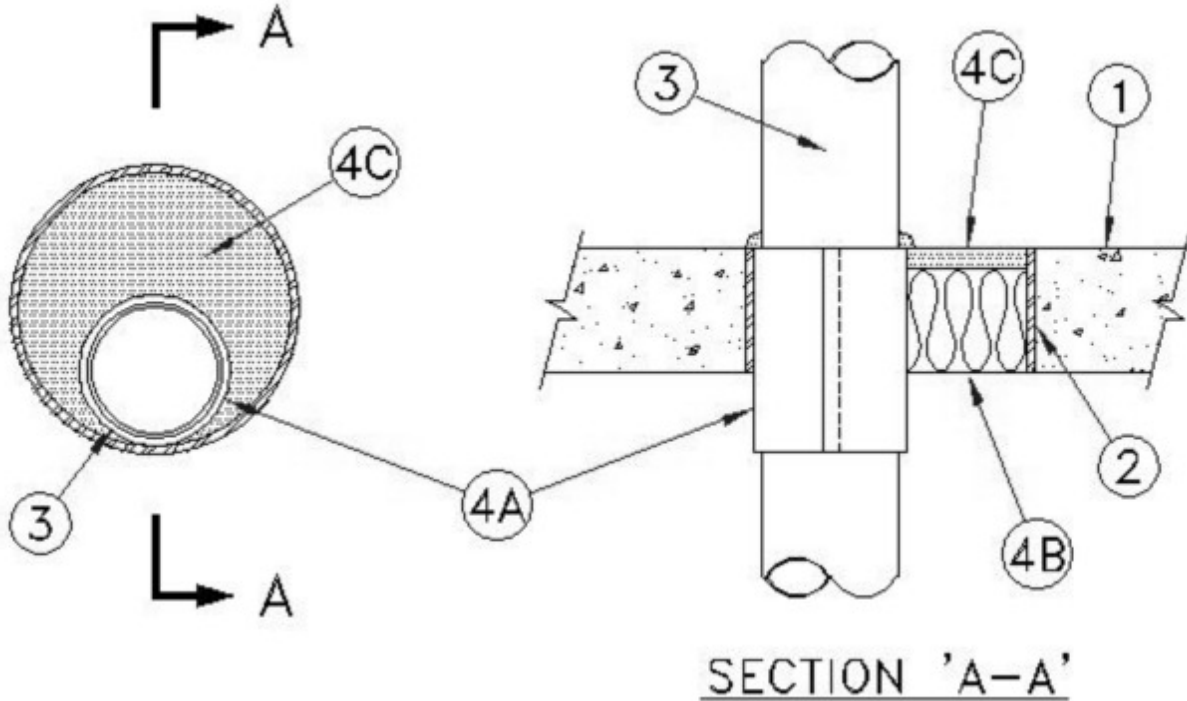

1. Floor or Wall Assembly — Min 4-1/2 in. (114 mm) thick floor or 5 in. (127 mm) thick wall of reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete. Floor may also be constructed of any min 6 in. (152 mm) thick UL Classified hollow-core **Precast Concrete Units***. Wall may also be constructed of any UL classified **Concrete Blocks***. Max diam of opening is 6 in. (152 mm).

See **Concrete Blocks (CAZT)** and **Precast Concrete Units (CFTV)** categories in the Fire Resistance Directory for names of manufacturers.

2. Nonmetallic Sleeve (Optional) — Nom 6 in. (152 mm) diam (or smaller) Schedule 40 polyvinyl chloride (PVC) pipe cast or grouted into floor or wall assembly, flush with floor or wall surfaces.

3. Through Penetrants — One nonmetallic pipe or conduit to be installed either concentrically or eccentrically within the firestop system. **F rating is 3 Hr when PVC pipes and Rigid Nonmetallic Conduits are used and 2 Hr when the other pipes shown below are used. T rating is 2-1/2 Hr when PVC pipes and Rigid Nonmetallic Conduits are used and 1 Hr when the other pipes shown below are used.** The pipe or conduit to be rigidly supported on both sides of floor or wall. The following types and sizes of nonmetallic pipes or conduits may be used:

A. Polyvinyl Chloride (PVC) Pipe — Nom 4 in. (102 mm) diam (or smaller) Schedule 40 cellular or solid core PVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.

B. Acrylonitrile Butadiene Styrene (ABS) Pipe — Nom 4 in. (102 mm) diam (or smaller) Schedule 40 solid core ABS pipe for use in closed (process or supply) piping systems.

C. Chlorinated Polyvinyl Chloride (CPVC) Pipe — Nom 4 in. (102 mm) diam (or smaller) SDR 13.5 CPVC pipe for use in closed (process or supply) piping systems.

D. **Rigid Nonmetallic Conduit+** — Nom 4 in. (102 mm) diam (or smaller) Schedule 40 PVC conduit installed in accordance with the National Electrical Code, (NFPA No. 70).

The required annular space is dependent upon the nom diam of the through penetrant as shown in the table below.

Nom Diam of Through Penetrant, In. (mm)	Min and Max Annular Space, In. (mm)
2 (51)	1/4, 1 (6, 25)
3(76)	1/2, 1 (13, 25)
4 (102)	1/2, 1 (13, 25)

4. **Firestop System** — The firestop system shall consist of the following:

A. **Firestop Device*** — Min 8 in. (203 mm) long galv steel sleeve lined with an intumescent material, sized to fit the specific diam of the through penetrant. Device to be wrapped around outer circumference of through penetrant and installed through the annular space of the opening. The device may be secured together by means of min 1/2 in. (13 mm) wide by 0.028 in. (0.71 mm) thick stainless steel hose clamps or min 1/8 in. (3.2 mm) diam by 1/2 in. (13 mm) long steel pop rivets spaced max 4 in. (102 mm) OC. As an option, the device may be secured together by means of 3/4 in. (19 mm) wide by 0.007 in. (0.18 mm) thick glass cloth electrical tape continuously wrapped twice around the outer circumference of through penetrant. In floors, the bottom of the device may be installed flush with the bottom surface of the floor or extend up to 3-1/2 in. (89 mm) below the bottom surface of the floor. In walls, the device shall be centered within the wall.

RECTORSEAL — FlameSafe® Intumescent Sleeve, Metacaulk Intumescent Sleeve or Biostop Intumescent Sleeve

B. **Packing Material** — Min 4 in. (102 mm) thickness of min 4 pcf (64 kg/m³) mineral wool batt insulation firmly packed into opening as a permanent form. Packing material to be recessed from top surface of floor or from both surfaces of wall to accommodate the required thickness of fill material. When the floor is constructed of hollow-core precast concrete units, packing material shall be recessed from both surfaces of floor to accommodate the required thickness of fill material.

C. **Fill, Void or Cavity Material* - Sealant** — Min 1/2 in. (13 mm) thickness of fill material applied within the annulus, flush with top surface of floor or with both surfaces of wall. When the floor is constructed of hollow-core precast concrete units, fill material shall be installed symmetrically on both sides of floor, flush with both floor surfaces. Additional fill material to be installed such that a min 1/2 in. (13 mm) bead is formed between any point-of-contact between the Intumescent Sleeve and edge of opening (if applicable) on top surface of floor or both surfaces of wall and hollow-core precast concrete units.

RECTORSEAL — FlameSafe® FS900+ Series, MC 150+ or BF-150+ Sealant

*Bearing the UL Classification Mark