



(800) 231-3345 www.biofireshield.com

Copyright - 2008 Underwriters Laboratories Inc.

Reprinted from the 2008 Fire Resistance Directory with permission from Underwriters Laboratories Inc.




System No. F-A-2044


June 03, 2011

F Rating — 2 Hr


T Ratings — 1 and 1-1/2 Hr (See Item 3)

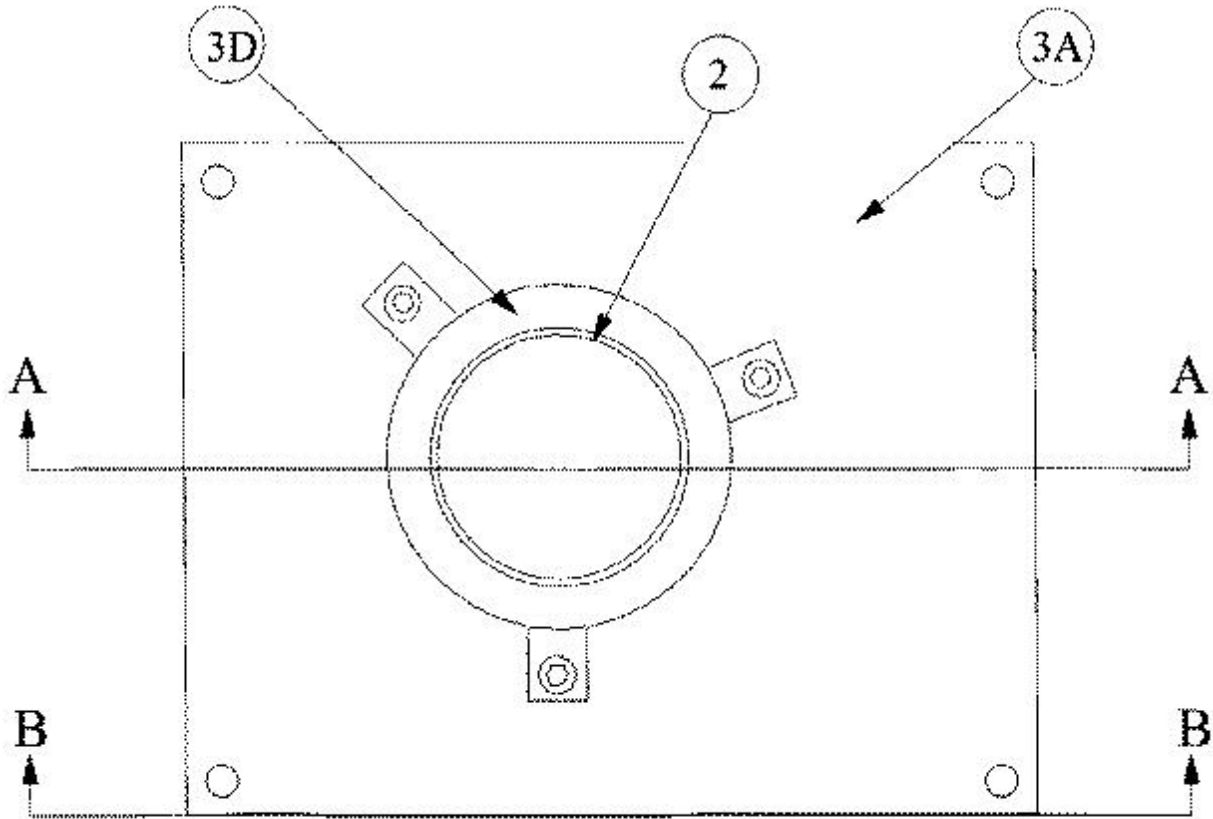

BOTTOM VIEW

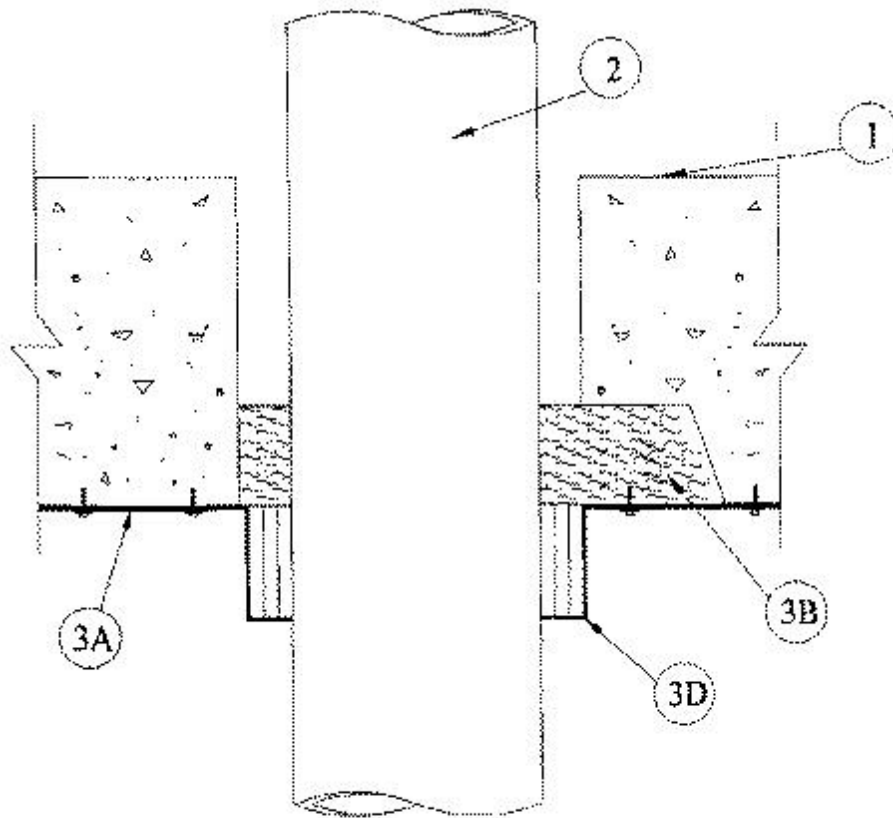

SECTION A-A

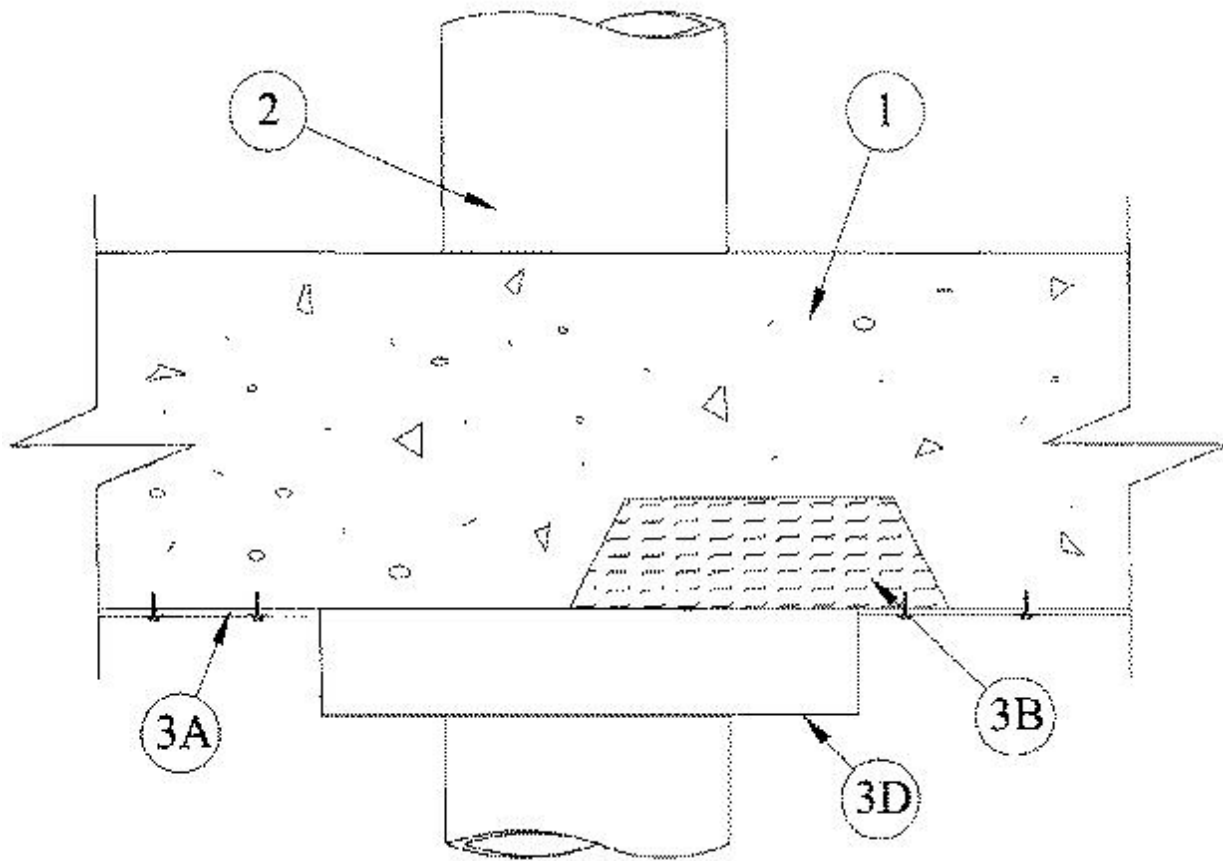

SECTION B-B

1. **Floor Assembly** — The fire-rated unprotected concrete and steel floor assembly shall be constructed of the material and in the manner specified in the individual D900 Series designs in the UL Fire Resistance Directory and as summarized below:

A. **Concrete** — Min 2-1/2 in. (64 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete.

B. **Steel Floor and Form Units*** — Composite or noncomposite 3 in. (76 mm) deep fluted galv units as specified in the individual Floor-Ceiling design. Diam of opening through floor shall be 1/2 to 5/8 in. (13 to 16 mm) larger than the outside diam of the through penetrant (Item 2). Max diam of opening core-drilled through floor assembly is 5 in. (127 mm).

2. **Through Penetrants** — One nonmetallic pipe to be centered within the firestop system. The annular space between pipe and periphery of opening shall be min 1/4 in. (6 mm) to max 5/16 in. (8 mm). Pipe to be rigidly supported on both sides of floor assembly. The following types and sizes of nonmetallic pipes may be used.

A. **Polyvinyl Chloride (PVC) Pipe** — Nom 4 in. (102 mm) diam (or smaller) Schedule 40 cellular or solid core PVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.

B. **Acrylonitrile Butadiene Styrene (ABS) Pipe** — Nom 4 in. (102 mm) diam (or smaller) Schedule 40 cellular or solid core ABS pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.

C. **Chlorinated Polyvinyl Chloride (CPVC) Pipe** — Nom 4 in. (102 mm) diam (or smaller) SDR 17 or Schedule 40 CPVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.

3. **Firestop System** — The details of the firestop systems shall be as follows:

A. **Metal Plate Enclosure** — Min 12 by 12 by 0.024 in. (305 by 305 by 0.61 mm) thick galv steel plate. Width of plate to extend a min of 3 in. (76 mm) beyond both sides of opening. Length of plate (transverse to steel floor unit direction) to extend to steel floor unit valley beyond each side of core-drilled hole with a min lap of 2-1/4 in. (57 mm) on the floor unit valley at each end. Circular cutout in plate to be 1/4 in. (6 mm) larger than the outside diameter of the through penetrant. Max diam of opening to be 4-3/4 in. (121 mm). Plate to be cut in half along the length of plate to permit installation around the nonmetallic pipe and secured to valley of floor units using min 1/4 in. (6 mm) diam by 1-1/4 in. (32 mm) long steel expansion bolts or steel Tapcon® concrete anchors. Fasteners to be located approximately 1/2 in. (13 mm) from edges of plate at each corner, at each plate/valley intersection and at max 11 in. (279 mm) OC along width. When plate seam is located beneath the crest of the steel deck, a 2 in. (51 mm) wide by 0.024 in. (0.61 mm) thick galv steel plate to be centered over seam and attached to plate with min No. 10 sheet metal screws, max 3 in. (76 mm) O.C. on both sides of seam.

B. **Packing Material** — Mineral wool batt insulation having min density of 4 pcf (64 kg/m³), firmly packed into flutes of steel floor units above metal plate enclosure to completely fill cavities. When mineral wool packing material is used, T Rating is 1 hr.

B1. **Fill, Void or Cavity Material - Caulk** — (Optional - Not Shown)
A 1/16 in. (1/6 mm) thick layer of sealant (wet) may be applied to the exposed surfaces of mineral wool (Item 3B).

RECTORSEAL Biostop 500+ or FS1900

C. **Fill, Void or Cavity Materials* — Mortar** — (Not Shown) —As an alternate to Item 3B, fill material troweled into flutes of steel floor units above metal plate enclosure to completely fill cavities. Material to be mixed with water in accordance with the mixing instructions on the bag. When mortar is used, T Rating is 1-1/2 hr.

RECTORSEAL — Bio K10+ Mortar or FlameSafe Mortar

D. **Firestop Device*** — Galv steel collar lined with an intumescent material sized to fit specific diam of the through penetrant. Device to be installed around through penetrant in accordance with accompanying installation instructions. Device incorporates anchor tabs for securement to underside of the metal plate enclosure. Device secured at each tab. Where anchor tabs are beneath the valley or the steel deck or the mortar, the anchor tabs are to be secured with min 1/4 in. (6 mm) diam by 1-1/4 in. (32 mm) long steel expansion bolts or steel Tapcon® concrete anchors in conjunction with min 5/16 by 5/8 in. (8 by 16 mm) diam washers. Where anchor tabs are beneath the packing material, the anchor tabs are to be secured with min 1/4 in. (6 mm) diam by 1-1/4 in. (32 mm) long self-drilling, self-tapping steel sheet metal screws in conjunction with min 5/16 by 5/8 in. (8 by 16 mm) diam washers.

RECTORSEAL — Biostop Pipe Collar or FlameSafe Pipe Collar

*Bearing the UL Classification Mark