

**Design Number TRC/BP 120-05**  
**PERIMETER FIRE BARRIERS**

Rectorseal Corporation

Biostop 750, Biostop 800, FlameSafe FS 3000, FlameSafe FS 4000, Metacaulk 1200 Spray, and Metacaulk 1500 Spray

**ASTM E 2307**

T-Rating- 1-3/4 hr

F-Rating-2 hr

**ASTM E 2307/ASTM E 1399 Cycling**


Class IV: 500 cycles @ 30 cpm

± 15% horizontal movement

± 6.25% vertical shear movement

**UL 2079**

L-Rating- <1.0 SCFM/LF

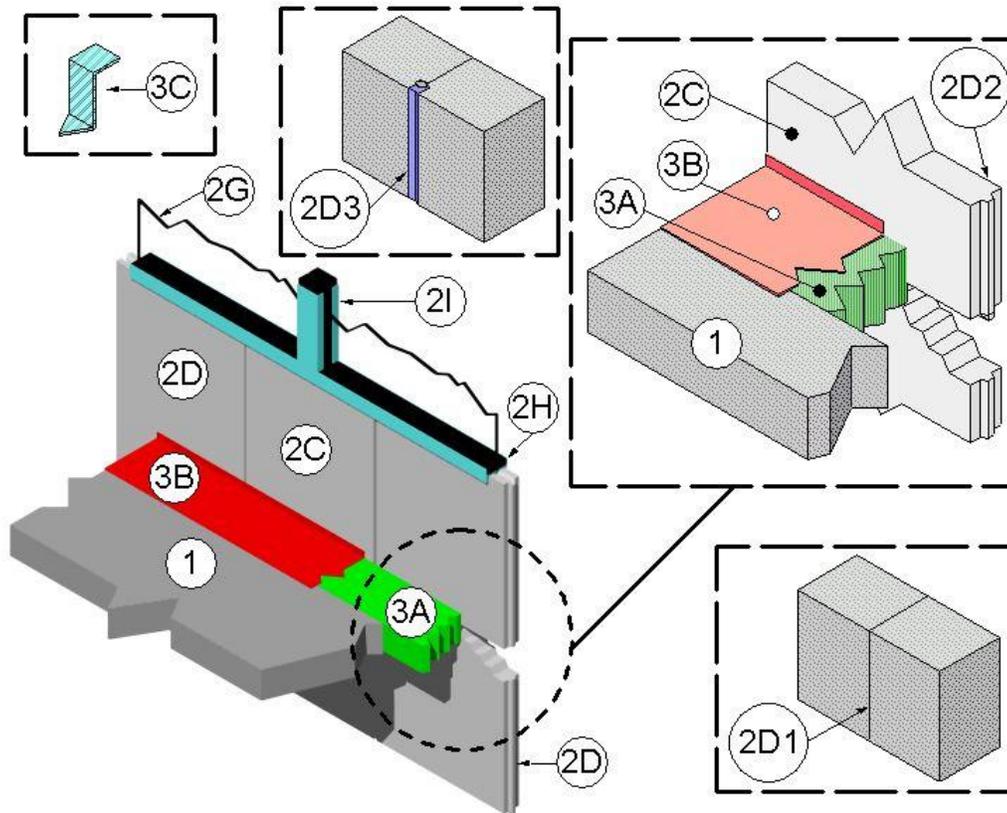

1. CONCRETE FLOOR ASSEMBLY: Two-hour rated concrete floor assembly made from either lightweight or normal weight concrete with a density of 100 to 150 pcf, having a min. thickness of 4-1/2 in. at the joint face. When a longitudinal recess (blockout) is required to contain an architectural joint system, increase

concrete floor assembly thickness to maintain a min. thickness of 4-1/2 in. and accommodate depth of blockout formed in the concrete: blockout width unrestricted.

2. CURTAIN WALL ASSEMBLY: Incorporate the following construction features:

## Division 07 Thermal Protection

### 07 84 00 Firestopping

#### 07 84 53 Building Perimeter Firestopping

- A. Panel Mounting Attachment: (Not shown) Install steel attachments to the tilt-up panels (Item 2C) and structural framing (Item 2B) according to the curtain wall manufacturer's instructions. When required, connect the mounting attachments to the joint face of the concrete floor assembly (Item 1) according to the curtain wall manufacturer's instructions. Limit distance between mounting attachments to max. 48 in..
- B. Structural Framing: (Not Shown) Install structural framing members according to the curtain wall system manufacturer's requirements. When aluminum is used, completely conceal aluminum structural framing with concrete panels.
- C. Tilt-up Panels: Use min. 1-1/2 in. thick, reinforced lightweight or normal weight (100 to 150 pcf density). Attach tilt-up panels to structural framing (Item 2B) according to the curtain wall system manufacturer's requirements.
- D. Concrete Panel Joint: No through joints allowed. When required, the surface of the concrete panel joints can be sealed with gaskets or sealants. Use one of the following for vertical and horizontal concrete panel joints
1. flush type (butt joint) or
  2. key way type (tongue and groove) or
  3. recessed.
- E. Curtain Wall Insulation: (Optional – Not Shown) When used, install either mineral wool or fiberglass batt curtain wall insulation after the perimeter joint protection (Item 3) installation. Attach curtain wall insulation to structural framing (Item 2B) or tilt-up panels (Item 2C) by friction fit or mechanical fasteners.
- F. Impaling Pins: (Optional – Not Shown) Use, locate, size, and install impaling pins according to the curtain wall system manufacturer's guidelines.
- G. Glass Vision Panels: (Optional) When used, locate glass vision panels above spandrel area and a min. 6 in. above the top surface of the concrete floor assembly (Item 1). Install glass vision panels to window framing (Item 2I) according to manufacturer's guidelines. Use a min. 1/4 in. thick, clear tempered glass with a max. 56-1/2 in. width and max. 69 in. height.
- H. Window Gaskets: When glass vision panels (Item 2G) used, use a thermal break (thermal-set rubber extrusion) to secure glass vision panels (Item 2G).
- I. Window Framing: When glass vision panels used, use steel framing members a min. 3-5/8 in. by 1-5/8 in., 18 GA steel, U-shaped channel or similar construction compatible with structural framing (Item 2B). Locate window framing at least 6 in. above the top surface of the concrete floor assembly (Item 1).
3. PERIMETER JOINT PROTECTION: Do not exceed an 8 inch nominal joint width (joint width at installation). Incorporate the following construction features for the perimeter joint protection (also known as perimeter fire barrier system):
- A. Packing Material: Use a min. 4 in. thick, 4-pcf density, mineral wool batt insulation installed with the fibers running parallel to the edge of concrete floor assembly (Item 1) and curtain wall assembly (Item 2). Cut packing material width to achieve 50% compression when installed in the nominal joint width. Compress the packing material into the perimeter joint. Tightly compress together splices (butt joints) in the lengths of packing material by using min. 1/4 in. compression per piece of packing material. Use only Intertek certified products meeting the above min. requirements. When a spray coating is used, locate the top surface of the packing material flush with the top surface of the concrete floor assembly (Item 1). When the non-sag or self leveling silicone sealant is used, recess the top surface of the packing material 1/4 in. from the top surface of the concrete floor assembly (Item 1).
- B. CERTIFIED MANUFACTURER: Rectorseal Corporation

**Division 07 Thermal Protection**  
**07 84 00 Firestopping**  
**07 84 53 Building Perimeter Firestopping**

CERTIFIED PRODUCT: Biostop, FlameSafe, Metacaulk

MODEL: Biostop 750, Biostop 800, FlameSafe FS 3000, FlameSafe FS 4000, Metacaulk 1200 Spray, or Metacaulk 1500 Spray

Fill, Void or Cavity Material: Apply either spray coating or non-sag or self leveling silicone sealant over the packing material (Item 3A) as follows:

Spray Coating – Spray apply the liquid to cover the exposed top surface of the packing material (Item 3A) compressed and installed in the perimeter joint. Apply a min. wet film thickness of 1/8 in. and overlap the spray coating a min. 1/2 in. onto the adjacent curtain wall assembly (Item 2) and concrete floor assembly (Item 1). When the spraying process is stopped and the applied spray coating cures to an

elastomeric film before installation process is restarted, then overlap the edge of the cured spray coating at least 1/8 in. with the liquid spray coating.

Sealant – Apply non-sag or self leveling sealant to cover the exposed surface of the packing material (Item 3A) compressed and installed in the perimeter joint. Apply min. 1/4 in. thickness non-sag or self leveling sealant over the packing material (Item 3A) and finish flush with the top surface of the concrete floor assembly (Item 1).

- C. Support Clips: (Optional)  
Recommended for installations subject to vertical shear movement. Use standard 20 GA galvanized steel Z-shaped clips having the following nominal dimensions: 1-in. wide by 3 in. high with a 2-in. upper leg and a 3 in. lower leg.