


System No. W-J-4032

April 03, 2003

F Rating — 2 Hr

T Rating — 3/4 Hr

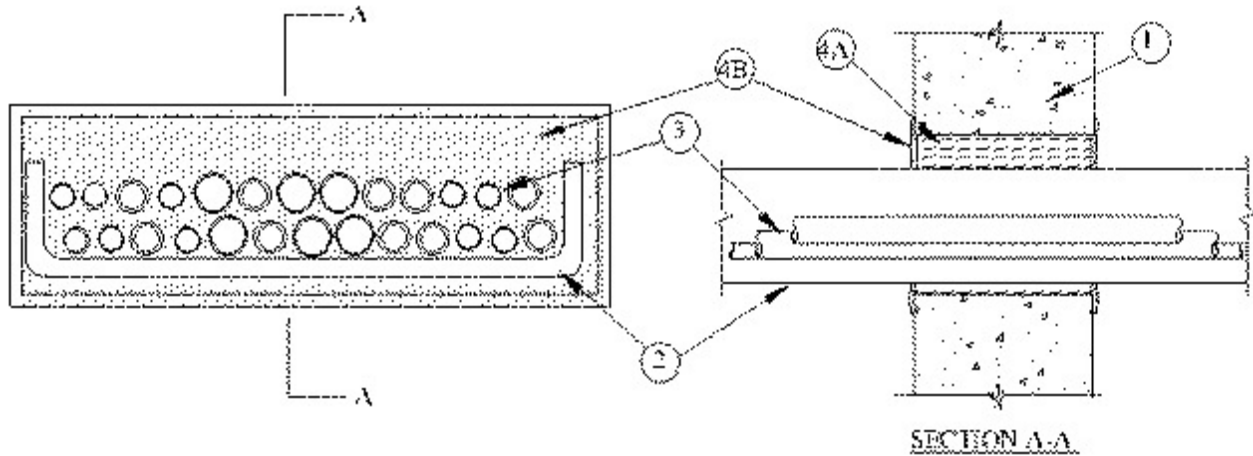

1. **Wall Assembly** — Min 6 in. thick reinforced lightweight or normal weight (100-150 pcf) concrete. Wall may also be constructed of any UL Classified **Concrete Blocks***. The max area of opening is 224 sq in. with max dimension of 28 in.

See **Concrete Blocks** (CAZT) category in the Fire Resistance Directory for names of manufacturers.

2. **Cable Tray*** — Max 24 in. wide by max 4 in. deep open ladder cable tray with channel-shaped side rails formed from 0.060 in. thick (No. 16 gauge) galv steel with nom 1 in. diam rungs spaced max 9 in. OC. The annular space between the cable tray and the periphery of the opening shall be min 1 in. to max 5 in. Cable tray to be rigidly supported on both sides of floor or wall assembly.

3. **Cables** — Aggregate cross-sectional area of cables in cable tray to be max 41 percent of the cross-sectional area of the cable tray based on a max 3 in. deep cable loading depth within the cable tray. Any combination of the following types and sizes of copper conductor cables may be used:

A. Max 300 pair, No. 24 AWG copper conductor communication cable with polyvinyl chloride insulation and jacket material.

B. Max - 25 pair, No.24 AWG copper conductor communication cable with polyvinyl chloride insulation and jacket material.

C. Max 750 MCM power cables, THHN or THWN jacketed.

D. Max 6 /C Commscope Optical Research 2001 fiber optic cable.

E. Max 12/C Commscope Optical Research 2001 fiber optic cable.

F. Max 8/C No. 12 AWG copper conductor Type THHN or THWN power cable.

4. **Firestop System** — The firestop system shall consist of the following:

A. **Packing Material** — Min 6 in. thickness of min 4 pcf mineral wool batt insulation firmly packed into opening as a permanent form, flush with both surfaces of wall.

B. **Fill Void or Cavity Materials* - Sealant** — Min 1/8 in. thickness of fill material applied over mineral wool on both surfaces of wall. Fill material to overlap 1/2 in. onto wall, cable tray and cables in cable tray. Additional fill material to be forced into cable interstices to max extent possible.

*Bearing the UL Classification Mark