


System No. WW-S-1038

February 10, 2014

Assembly Rating — 2 Hr

Joint Width — 4 In. Max

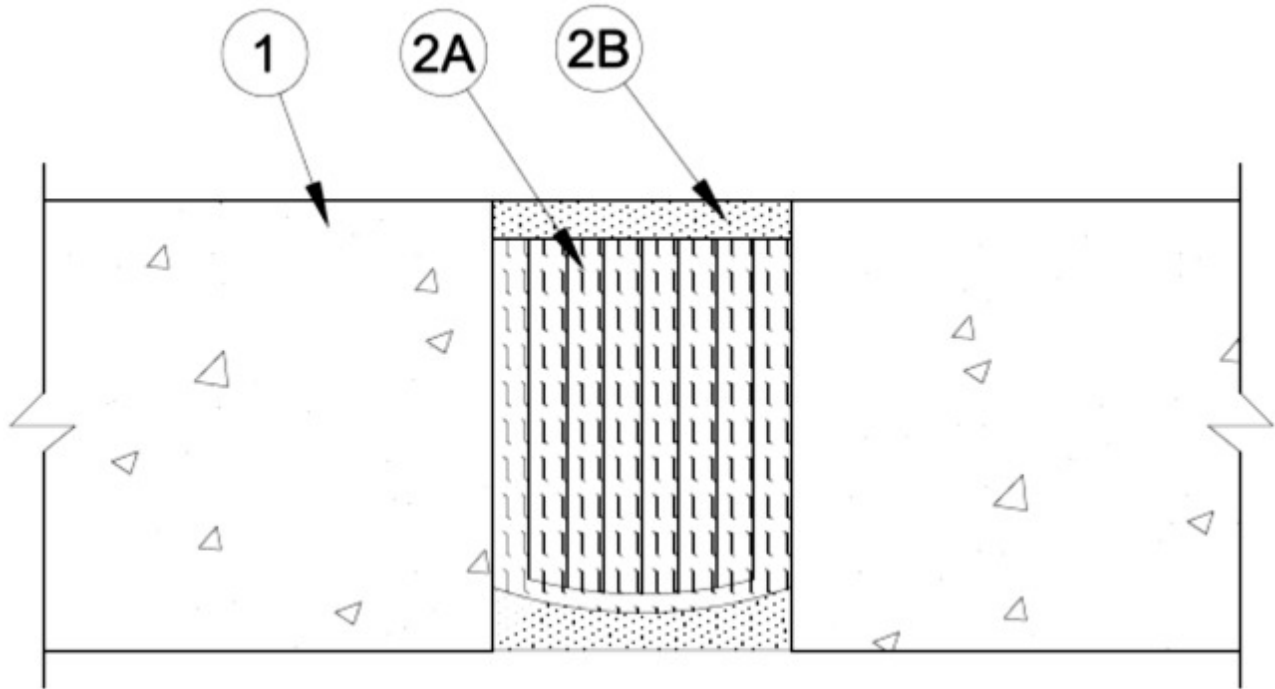

1. Wall Assembly — Min 5 in. (127 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete. Wall may also be constructed of any UL Classified **Concrete Blocks***.

See **Concrete Blocks** (CAZT) category in the Fire Resistance Directory for names of manufacturers.

2. Joint System — Max width of joint is 4 in. (102 mm). The joint system shall consist of the following:

A. Forming Material* — Nom 11 in. (279 mm) wide by 3-3/8 in. (86 mm) thick blanket folded in half and compressed min 40 percent in thickness. Forming material installed into opening as a permanent form and to be recessed from each surface of wall to accommodate the required thickness of fill material.

BACKER ROD MFG INC — ULTRA BLOCK®

B. Fill, Void or Cavity Material* — Min 1/2 in. (13 mm) thickness of fill material applied within the joint, flush with each surface of wall.

RECTORSEAL — FS4000 Sealant, Metacaulk 835+, Biotherm 100

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.